

## Data sheet

# Actuators for three point control

**AMV 25 SD** - safety function (spring down)

**AMV 25 SU** - safety function (spring up)

### Description



AMV 25 SD or SU electric actuators are used with valves gen.2009 type VRB, VRG, VF, VL with additional adapter (Code No. 065Z0311, not supplied) and VFS 2 valves up to DN 50 diameter.

The actuator automatically adapts its stroke to valve end positions which reduces commissioning time. Optional auxiliary switches, feedback potentiometer and valve stem heater are available.

The actuator has some special features:

- The advanced design incorporates load related 'switch-off' to ensure that actuators and valves are not exposed to overload;
- Digitale feedback end position indication signal for valve end position is available by terminal 4 or 5;
- Low weight and robust;
- Safety function versions:
  - SD (spring down)
  - SU (spring up).

#### Main data:

- Nominal voltage:
  - 24 VAC, 50 Hz/60 Hz
  - 230 VAC, 50 Hz/60 Hz
- Control input signal: 3 point
- Force: 450 N
- Stroke: 15 mm
- Speed: 15 s/mm
- Max. medium temperature: 150 °C
- End-position signals

### Ordering

#### Actuator

Type	Supply voltage	Code No.
AMV 25 SD (spring down)	24 V~	<b>082H3036</b>
AMV 25 SU (spring up)	24 V~	<b>082H3039</b>
AMV 25 SD (spring down)	230 V~	<b>082H3037</b>
AMV 25 SU (spring up)	230 V~	<b>082H3040</b>

#### Accessories

Type	Code No.
Additional switches (2x)	<b>082H7015</b>
Additional switches (2x) and potentiometer (10 kΩ)	<b>082H7016</b>
Additional switches (2x) and potentiometer (1 kΩ)	<b>082H7017</b>
Adapter for VFS 2 valve DN 15-50 (for media temp. over 150 °C)	<b>065Z7548</b>
Adapter for VRB/VRG/VF/VL valves (gen.2009) DN 15-50	<b>065Z0311*</b>
Stem heater for VFS 2 valve DN 15-50	<b>065B2171</b>

\* Need to be ordered separately.

Technical data


Power supply	V	24, 230 AC
Power consumption	VA	12
Frequency	Hz	50/60
Control input		3-point
Close of force	N	450
Max. stroke	mm	15
Speed	s/mm	15
Max. medium temperature		150 (200 - for VFS valve with adapter)
Ambient temperature	°C	0...55
Storage and transport temp.		-40 ... 70
Protection code		IP 54
Weight	kg	2,3
marking in accordance with standards		EMC Directive 89/336/EEC, 92/31/EEC, 93/68/EEC, EN 50081-1 and EN 50082-1 Low Voltage Directive 73/23/EEC and 93/68/EEC, EN 60730/2/14

Safety function


The safety function will fully open or close the valve by power failure, depending upon the chosen safety action (SD/SU). Valve selection will also affect the safety action. The safety function unit is factory fitted to the rear of the actuator.

• not in accordance to DIN EN 14597

Valve type	Spring action selection will	
	Close port A-AB	Open port A-AB
VRG, VRB	SU	SD
VL (DN 15-50)	SU	SD
VF (DN 15-50)	SU	SD
VFS 2 (DN 15-50)	SD	SU

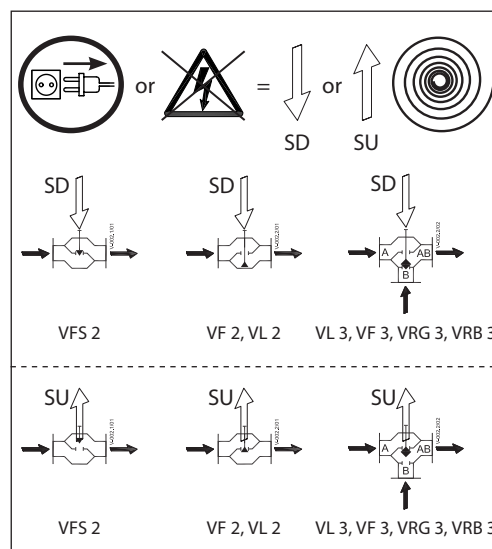


Safety function activation  
(AMV 25 SD only)

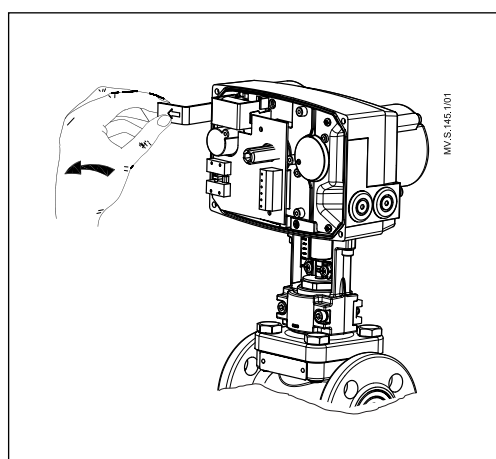

Disposal

The actuator must be dismantled and the elements sorted into various material groups before disposal.

Installation

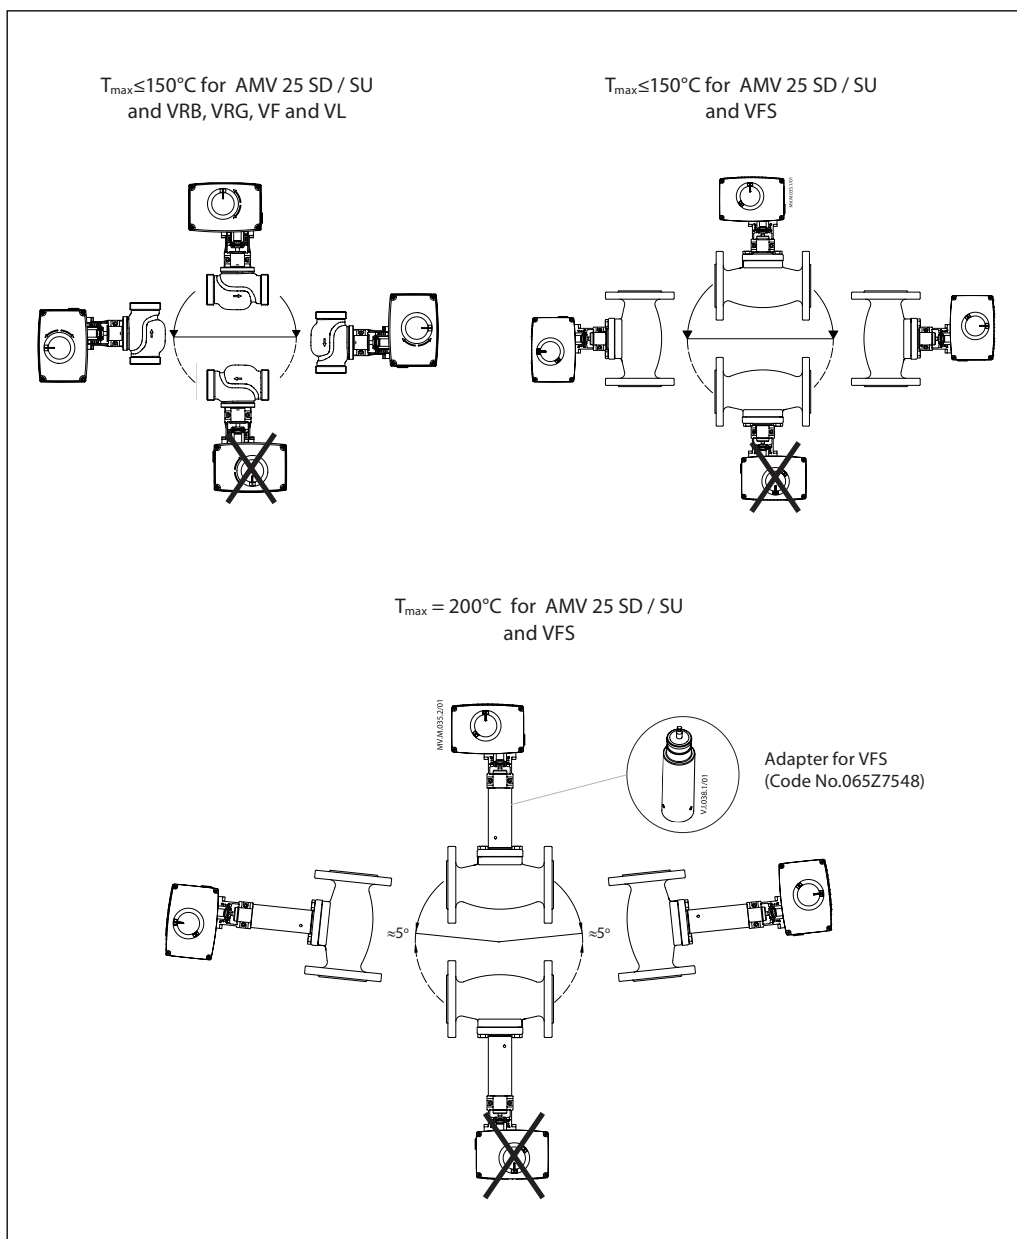

**Mechanical**

Use 4 mm Allan key (not part of actuator delivery) to mount actuator on the valve. Installation of the valve with the actuator is allowed in horizontal position or upwards. Installation downwards is not allowed.

The actuator must not be installed in an explosive atmosphere, at ambient temperature lower than 0 °C or at ambient temperature higher than 55 °C. It must not be subject to steam jets, water jets or dripping liquid as well.

**Note:** the actuator may be rotated up to 360° with respect to the valve stem by loosening the retaining fixture. Once the actuator is placed, retighten the fixture.

**Electrical**

Electrical connections can be accessed by removing the actuator cover. Two cable gland entries with thread (M20 x 1.5 and M16 x 1.5) are prepared for cable glands.


**Note:** Cable and cable gland used must not compromise the actuator's IP rating, and must ensure the connectors are fully strain relieved. Please observe local rules and regulations as well.

**Wiring**



**230 VAC version:**

Do not touch anything on the PCB!  
Do not remove the cover before the power supply is fully switched off.

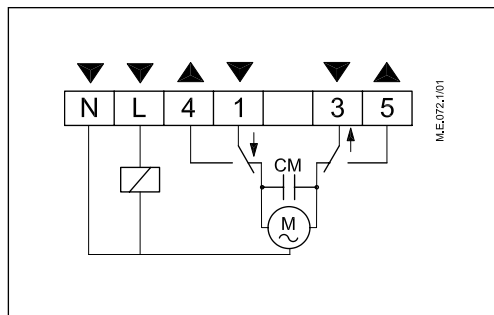

**Terminals 1, 3:**

Control voltage input from the controller.

**Terminals 4, 5:**

Output used for position indication or monitoring.


**L**

Power supply 24 or 230 V~


**N**

Common (0 V)


**Accessories**

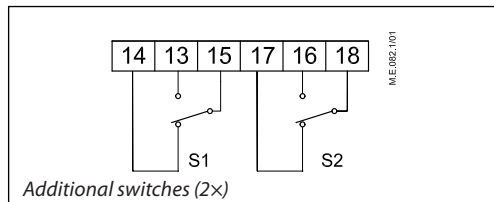

Additional switches (2x)

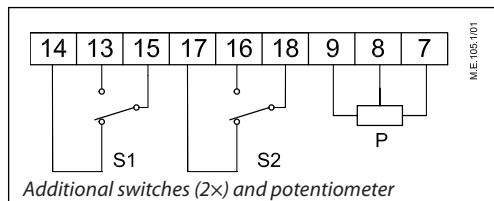

Additional switches (2x) and potentiometer

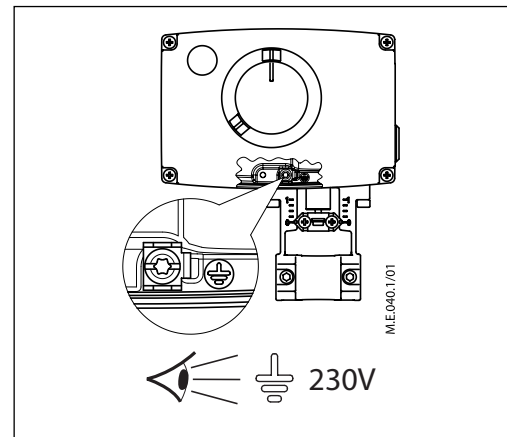


**Commissioning**

Complete the mechanical and electrical installation and perform the necessary checks and tests:

- Turn on the power.
- Set the appropriate control signal and check that the valve stem direction is correct for the application.

The unit is now fully commissioned.

**Manual override**

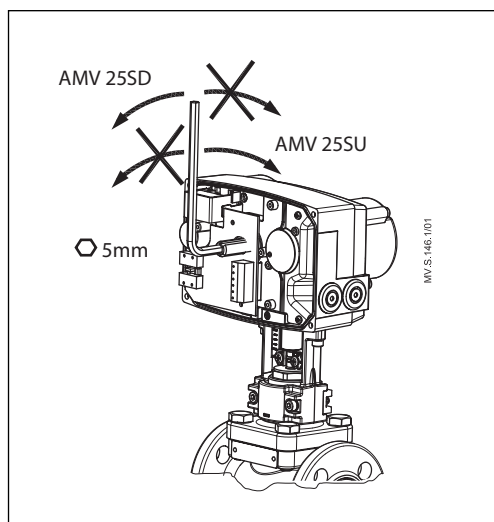

Manual override is done by means of positioning spindle inside the actuator:


- Disconnect power signal
- Remove the actuator cover
- Insert 5 mm Allan key (not part of actuator delivery) into the top of the positioning spindle
- Turn the key against the spring (observe the rotation direction)

To hold a manual override position, the key must be wedged.

After manual override is not needed:

- Restore power signal.

Dimensions

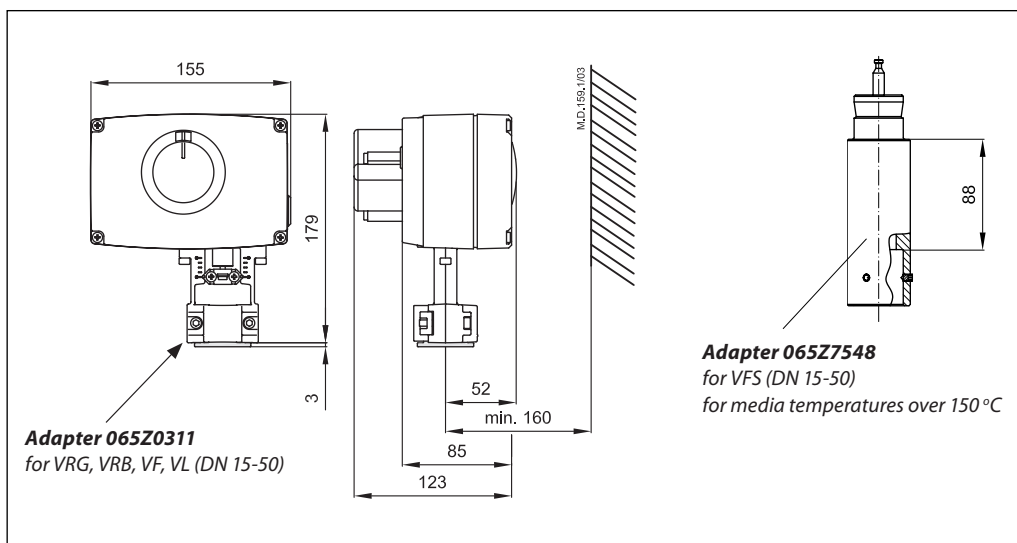

Actuator - valve combinations

